

4



3

2

1

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

Abv.	Name	Size
VK	Supply	2 1/2
RK	Return	2 1/2
AKO	Condensate Drain	1

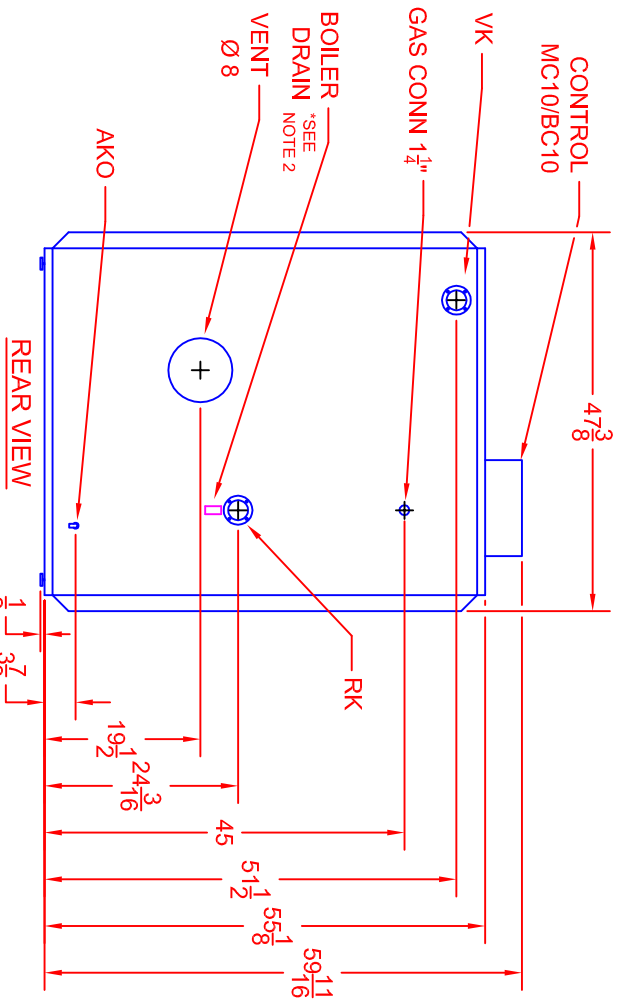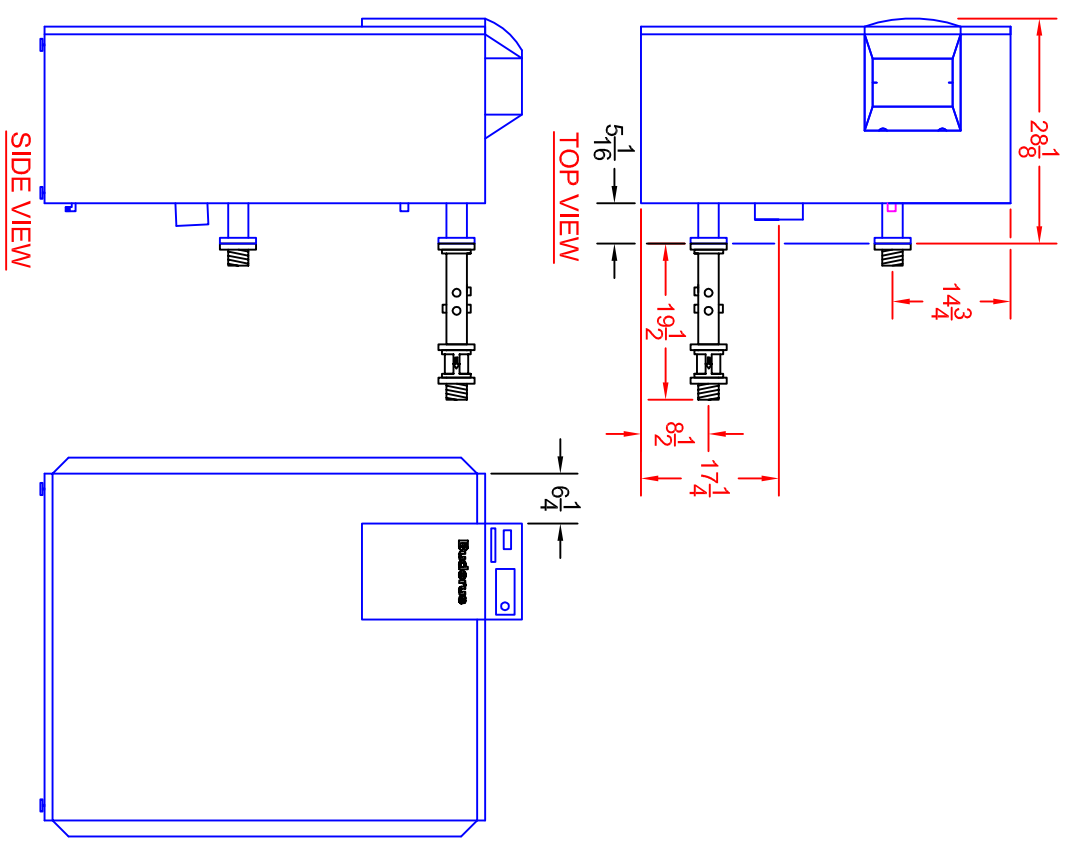

NOTE 1. All dimensions are in inches.  
 2. Boiler drain is located inside of the boiler on the return pipe. The diameter is 1/2"

Bosch Thermotechnology Corp.  
 50 Wentworth Ave.  
 Londonderry, NH 03053  
 Phone: 603-652-1100

This drawing is the exclusive property of Bosch Thermotechnology Corporation, it may not be reproduced or given to third parties.

**Buderus**  
 Bosch Group

Bosch Thermotechnology Corp.

Drawn By: M SPIRIDIDLOIZZI  
 Approved By: J MILLS

DESCRIPTION: GB312-200 BOILER DIMENSION SPECIFICATIONS  
 SIZE SCALE: A NTS  
 PART NO.: BTC 431006104 A  
 REV.:

Tolerance  
 Fraction=±1/16"  
 x.x=±0.030  
 x.xx=±0.015  
 x.xxx=±0.005  
 (UNLESS OTHERWISE NOTED)

DATE 5/1/2009  
 SHEET 1 of 1

4

3

2

1