REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

Abrv.	Name	Size
VK	Supply	2 1/2
RK	Return	2 1/2
AKO	Condensate Drain	1

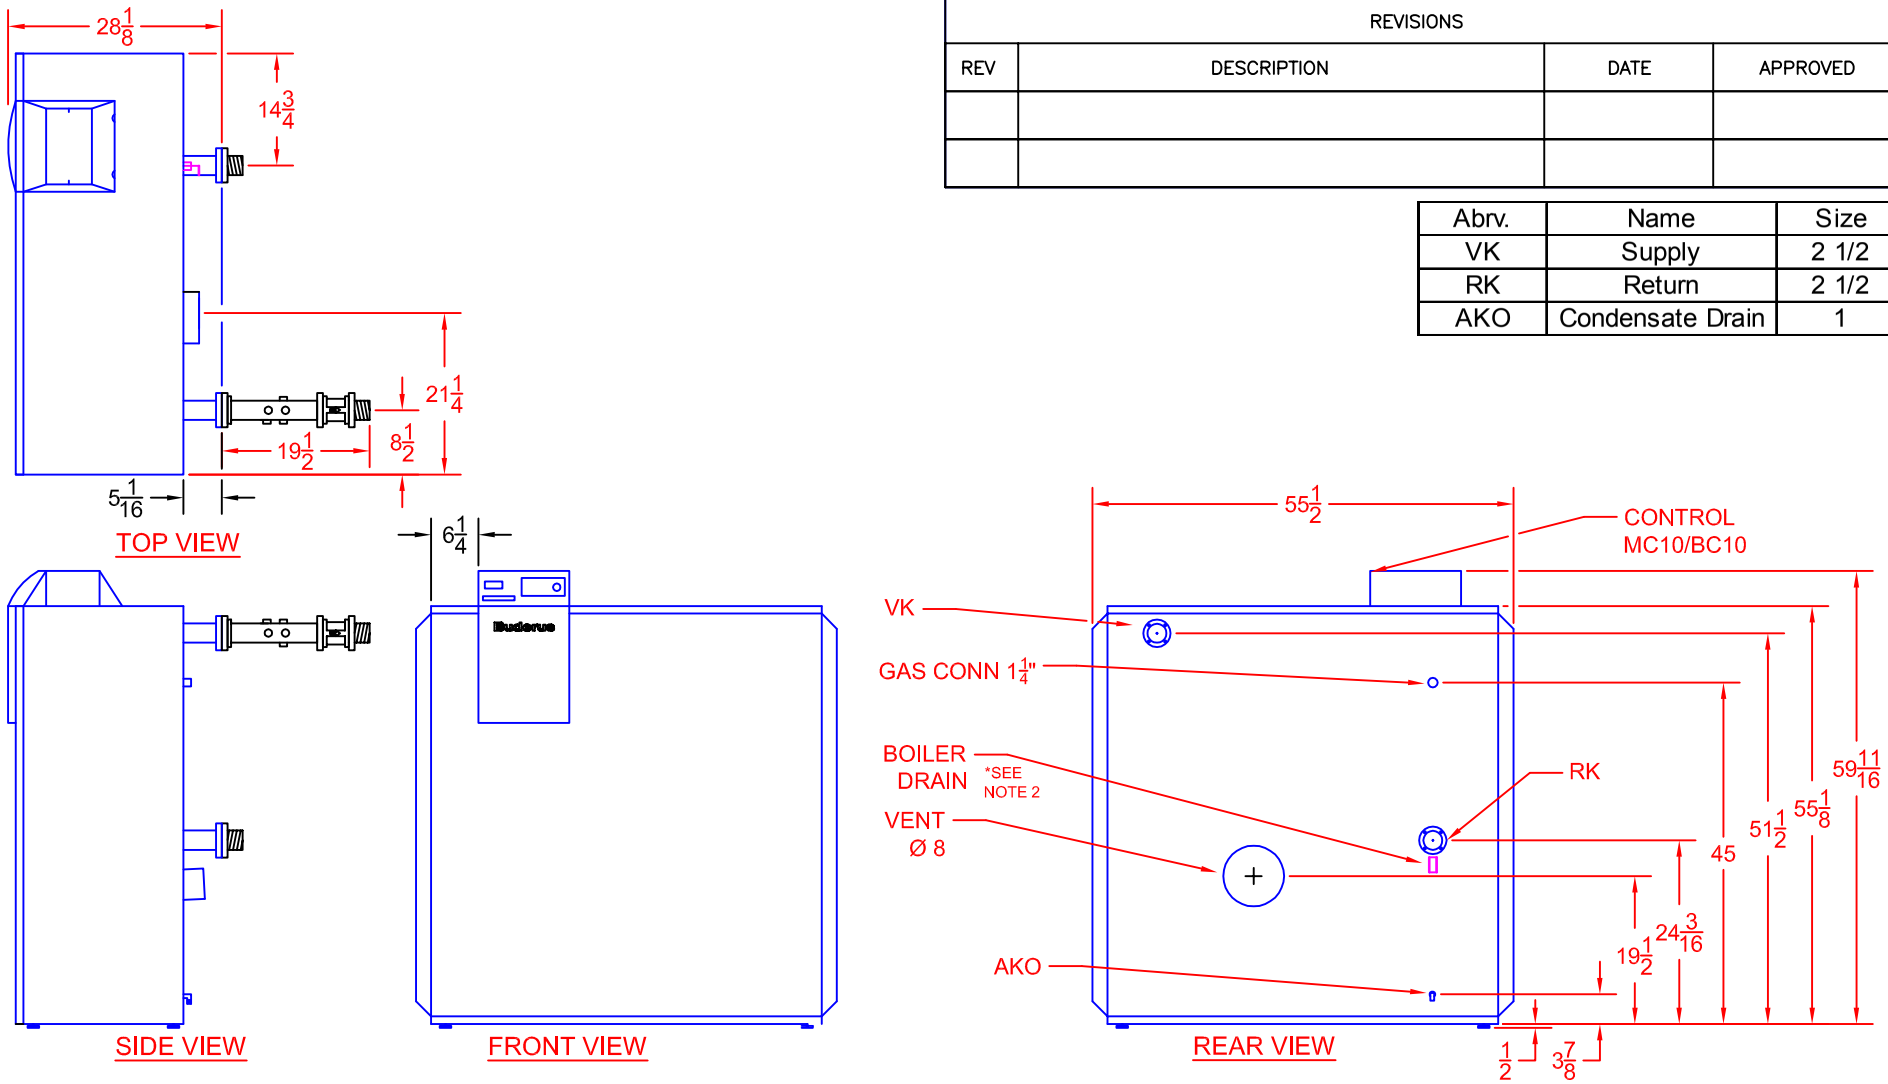

NOTE 1. All dimensions are in inches.

2. Boiler drain is located inside of the boiler on the return pipe. The diameter is 1/2"

Bosch Thermotechnology Corp.
50 Wentworth Ave.
Londonderry, NH 03053
Phone: 603-552-1100

Tolerance

Fraction=±1/4"
x.x=±0.030
x.xx=±0.015
x.xxx=±0.005

(UNLESS OTHERWISE NOTED)

This drawing is the exclusive property of Bosch Thermotechnology Corporation, it may not be reproduced or given to third parties.

Drawn By: M SPIRIDIGLOIZZI

Approved By: J MILLS

Buderus
Bosch Group

Bosch Thermotechnology Corp.

DESCRIPTION
GB312-280 BOILER DIMENSION SPECIFICATIONS

SIZE	SCALE	PART NO.	REV.
A	NTS	BTC 431006106 A	

DATE 5/1/2009

SHEET 1 of 1